work of providing, laying 100mm dia DI water supply pipeline in place of 75mm/100mm dia,corroded CI line in Vinobhanagara,SGN Layout and Surrounding areas to reduce contamination and freequent leak under VV Puram Service station of AEE SW2 Sub-Division area:

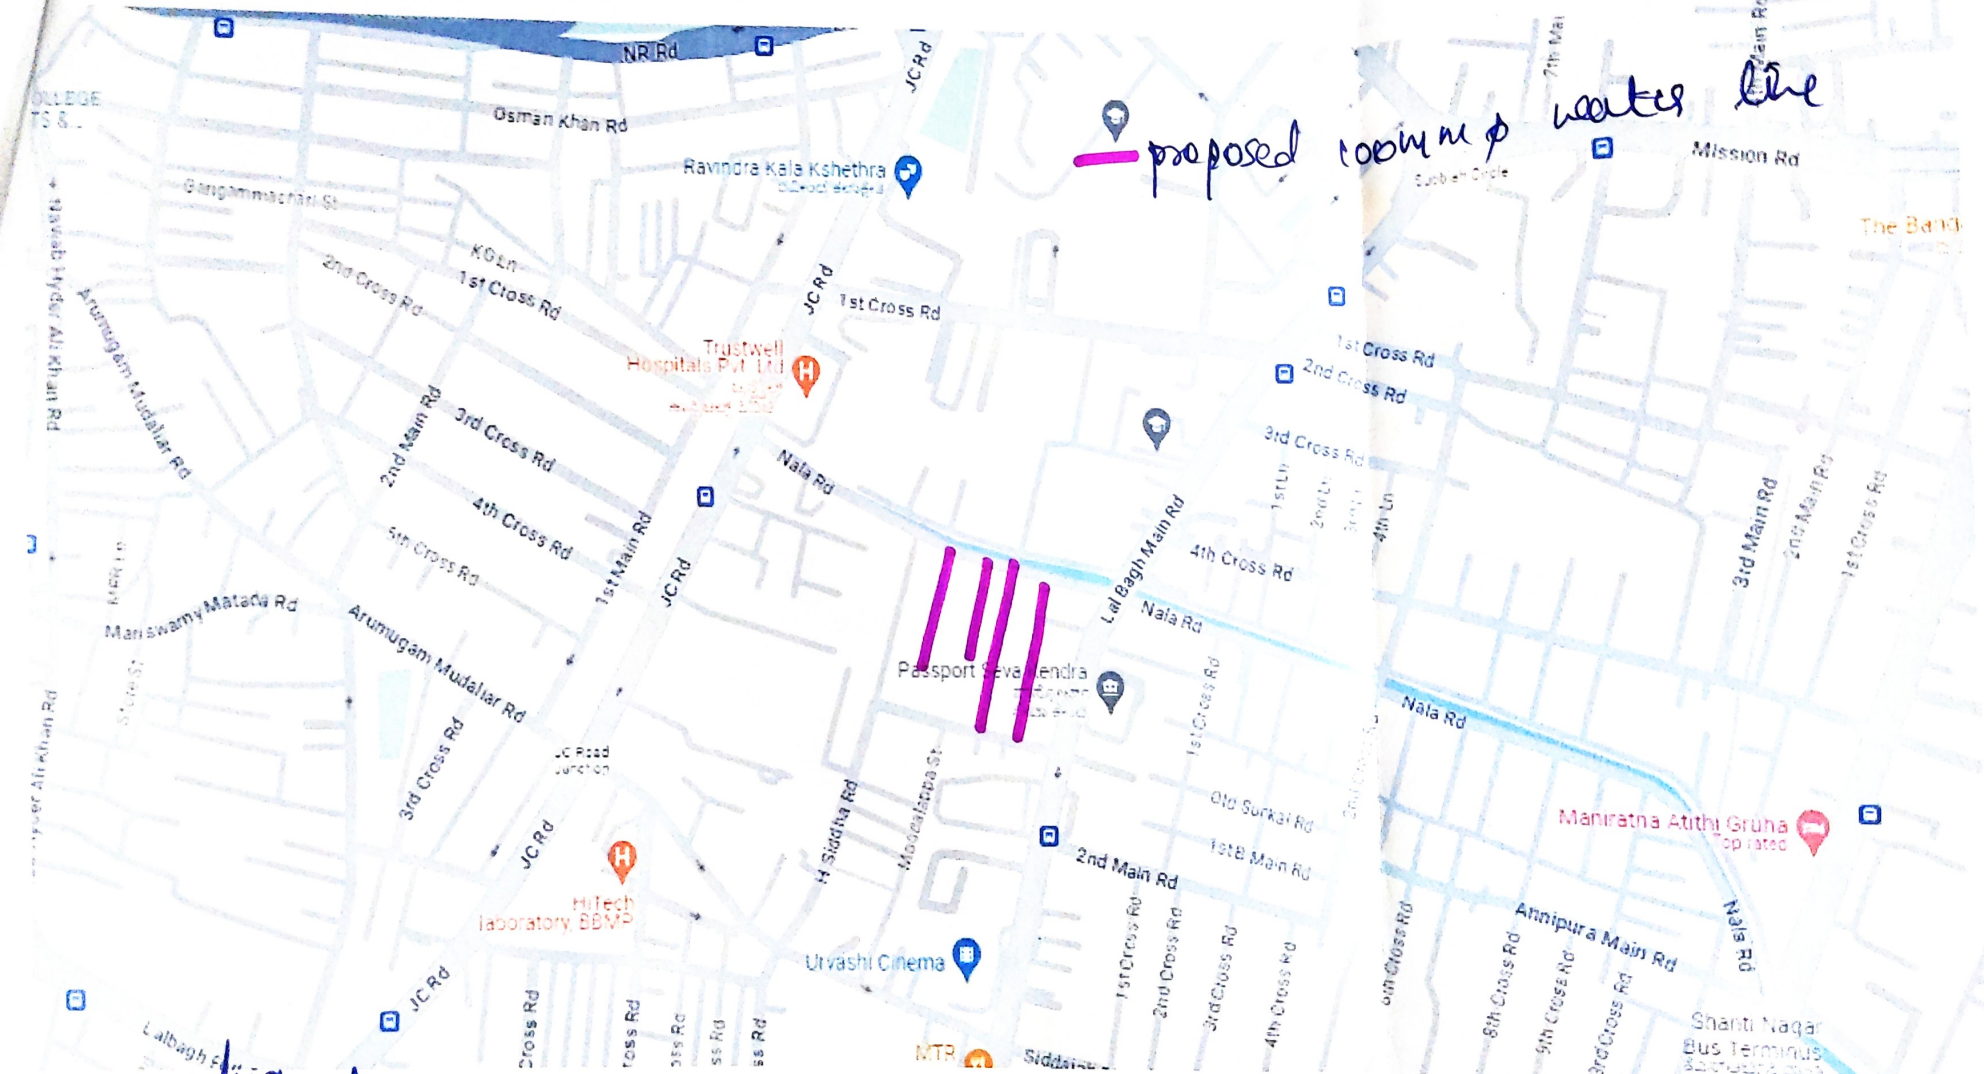

JE VVP

AEESW-2

EESW-1

Scanned with ACE Scanner